



PRODUCT TESTING SERVICE

100 Clemson Research Blvd. Anderson, SC 29625 Tel (864) 646-TILE Fax (864) 646-2821

TEST REQUESTED BY:

Trikeenan Tileworks
Attn: Stephen Powers
P.O. Box 22
Keene, NH 03431

TEST SUBJECT MATERIAL:

Identified by client as: Modulus Collection

TEST DATE:

11/21/07

TEST PROCEDURE:

ASTM C1028: "Standard Test Method for Determining the Static Coefficient of Friction of Ceramic Tile and Other Like Surfaces by the Horizontal Dynamometer Pull-Meter Method"
-A Chatillon DFIS 100 digital force gauge was used to measure each pull in pounds-force.
-A 3 x 3 x 1/8-inch piece of Neolite was used as the sensor.

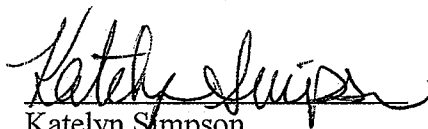
TEST RESULTS:


The average static coefficient of friction of four (4) pulls on each tile was as follows: *

	<u>As Received</u>	<u>After Cleaning</u>
Tile 1: <u>Dry:</u>	<u>0.80</u>	<u>0.80</u>
<u>Wet:</u>	<u>0.61</u>	<u>0.61</u>
Tile 2: <u>Dry:</u>	<u>0.78</u>	<u>0.79</u>
<u>Wet:</u>	<u>0.61</u>	<u>0.63</u>
Tile 3: <u>Dry:</u>	<u>0.77</u>	<u>0.80</u>
<u>Wet:</u>	<u>0.60</u>	<u>0.63</u>

The average static coefficient of friction of twelve (12) pulls was as follows:

<u>Dry:</u>	<u>0.78</u>	<u>0.79</u>
<u>Wet:</u>	<u>0.61</u>	<u>0.62</u>


Katelyn Simpson
Laboratory Engineer


Date